


Features

- 1-channel isolated barrier
- 24 V DC supply (loop powered)
- Current input/output 0 mA ... 40 mA
- I/P or transmitter power supply
- Accuracy 1 %
- Reverse polarity protection
- Up to SIL 2 acc. to IEC 61508


Function

This isolated barrier is used for intrinsic safety applications. The device transfers DC signals of fire alarms and smoke alarms from the hazardous area to the non-hazardous area. The device can also be used to control I/P converters, valves, indicators, and audible alarms. A reverse polarity protection prevents damage to the device caused by faulty wiring. The device is loop powered. From the control side no additional power supply has to be connected. Use the technical data to verify that proper voltage is available to the field devices.

Assembly

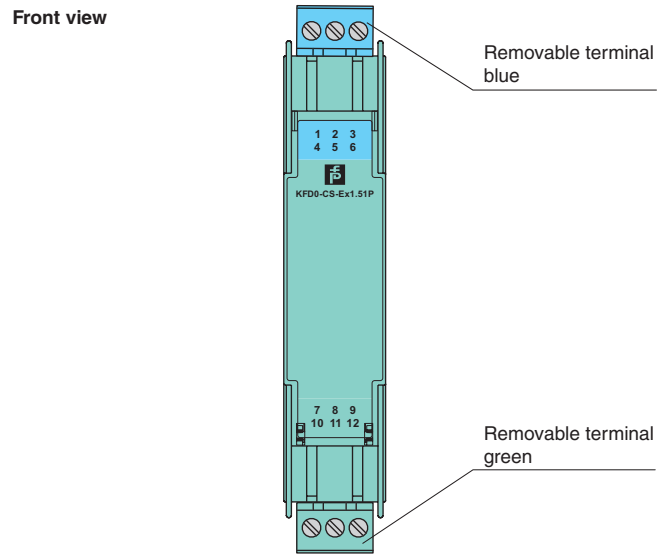

Connection

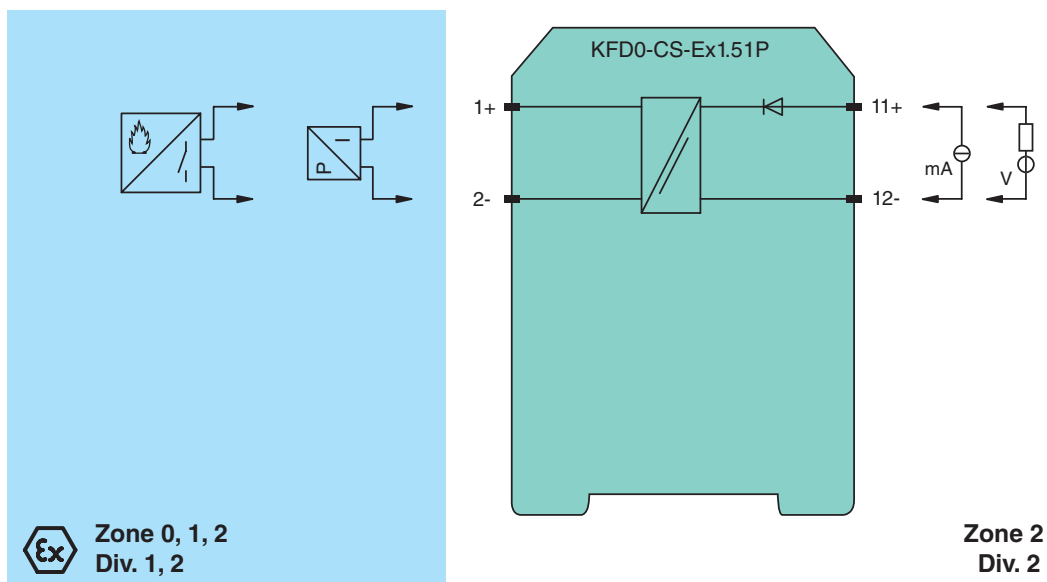

Release date 2017-08-09 14:20 Date of issue 2017-08-09 072147_eng.xml

| | | |
|--|-------|--|
| General specifications | | |
| Signal type | | Analog input/analog output |
| Functional safety related parameters | | |
| Safety Integrity Level (SIL) | | SIL 2 |
| Supply | | |
| Rated voltage | U_r | loop powered |
| Control circuit | | |
| Connection | | terminals 12-, 11+ |
| Voltage | | 4 ... 35 V DC |
| Current | | 0 ... 40 mA |
| Power dissipation | | at 40 mA and $U_{in} < 22 V$: 700 mW per channel at 40 mA and $U_{in} > 22 V$: 1.2 W per channel |
| Field circuit | | |
| Connection | | terminals 1+, 2- |
| Voltage | | for $4 V < U_{in} < 24 V$: $\geq U_{in} - (0.37 \times \text{current in mA}) - 1.0$ for $U_{in} > 24 V$: $\geq 21 V - (0.36 \times \text{current in mA})$ |
| Short-circuit current | | at $U_{in} > 24 V$: $\leq 65 mA$ |
| Transfer current | | $\leq 40 mA$ |
| Transfer characteristics | | |
| Accuracy | | 1 % |
| Deviation | | |
| After calibration | | $\leq \pm 200 \mu A$; incl. calibration, linearity, hysteresis and load fluctuations at the field side up to a load of 1 k Ω and current $\leq 20 mA$ at 20 °C (68 °F) |
| Influence of ambient temperature | | $\leq \pm 2 \mu A/K$ at $U_{in} \leq 20 V$; $\leq \pm 5 \mu A/K$ at $U_{in} > 20 V$ |
| Rise time | | $\leq 5 ms$ at bounce from 4 ... 20 mA and $U_{in} < 24 V$ |
| Galvanic isolation | | |
| Field circuit/control circuit | | safe electrical isolation acc. to IEC/EN 60079-11, voltage peak value 375 V |
| Indicators/settings | | |
| Labeling | | space for labeling at the front |
| Directive conformity | | |
| Electromagnetic compatibility | | |
| Directive 2014/30/EU | | EN 61326-1:2013 (industrial locations) |
| Conformity | | |
| Electromagnetic compatibility | | NE 21:2006 |
| Degree of protection | | IEC 60529:2001 |
| Protection against electrical shock | | UL 61010-1 |
| Ambient conditions | | |
| Ambient temperature | | -20 ... 60 °C (-4 ... 140 °F) |
| Mechanical specifications | | |
| Degree of protection | | IP20 |
| Connection | | screw terminals |
| Mass | | approx. 100 g |
| Dimensions | | 20 x 107 x 115 mm (0.8 x 4.2 x 4.5 inch) , housing type B1 |
| Mounting | | on 35 mm DIN mounting rail acc. to EN 60715:2001 |
| Data for application in connection with hazardous areas | | |
| EU-Type Examination Certificate | | BAS 98 ATEX 7343 |
| Marking | | Ex II (1)G [Ex ia Ga] IIC, II (1)D [Ex ia Da] IIIC, I (M1) [Ex ia Ma] I (-20 °C $\leq T_{amb} \leq 60$ °C) |
| Voltage | U_o | 25.2 V |
| Current | I_o | 93 mA |
| Power | P_o | 585 mW |
| Control circuit | | |
| Maximum safe voltage | U_m | 250 V _{eff} (Attention! The rated voltage can be lower.) |
| Field circuit | | |
| Maximum safe voltage | U_m | 250 V _{eff} (Attention! The rated voltage can be lower.) |
| Certificate | | TÜV 99 ATEX 1499 X |
| Marking | | Ex II 3G Ex nA II T4 [device in zone 2] |
| Galvanic isolation | | |
| Field circuit/control circuit | | safe electrical isolation acc. to IEC/EN 60079-11, voltage peak value 375 V |
| Directive conformity | | |
| Directive 2014/34/EU | | EN 60079-0:2012+A11:2013 , EN 60079-11:2012 , EN 60079-15:2010 |
| International approvals | | |
| FM approval | | |
| Control drawing | | 116-0129 |
| UL approval | | |

Release date 2017-08-09 14:20 Date of issue 2017-08-09 072147_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com

| | |
|----------------------------|---|
| Control drawing | 116-0173 (cULus) |
| IECEX approval | IECEX BAS 05.0004 |
| Approved for | [Ex ia Ga] IIC, [Ex ia Da] IIIC, [Ex ia Ma] I |
| General information | |
| Supplementary information | Observe the certificates, declarations of conformity, instruction manuals, and manuals where applicable. For information see www.pepperl-fuchs.com . |

Release date 2017-08-09 14:20 Date of issue 2017-08-09 072147_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com

Application

The device is used for isolation of power loops for the control of positioner, I/P converters etc. A current source is connected to the safe area terminals.

The device is used for isolation of a current signal from fire detectors or similar sensors. In this case, a voltage source can be connected to the safe area terminals. A specific measurement current across a passive sensor can be measured in the safe area with a series resistor (min. 50 Ω). When a voltage supply is used, the measuring resistor can also provide current limitations.