

Features


- 2-channel
- Inputs with plug-in Ex e terminals
- Module can be exchanged under voltage (hot swap)
- Installation in suitable enclosures in Zone 1
- Dry contact or NAMUR inputs
- Galvanic isolation between channels and the bus
- Positive or negative logic selectable
- Simulation mode for service operations (forcing)
- Line fault detection (LFD)
- Permanently self-monitoring

Function


The device accepts digital input signals of NAMUR sensors or mechanical contacts from the hazardous area. Open and short circuit line faults are detected. The device is supplied with plug-in Ex e terminals and protective cover.

The increased safety inputs are galvanically isolated from each other, the bus, and the power supply.

Assembly

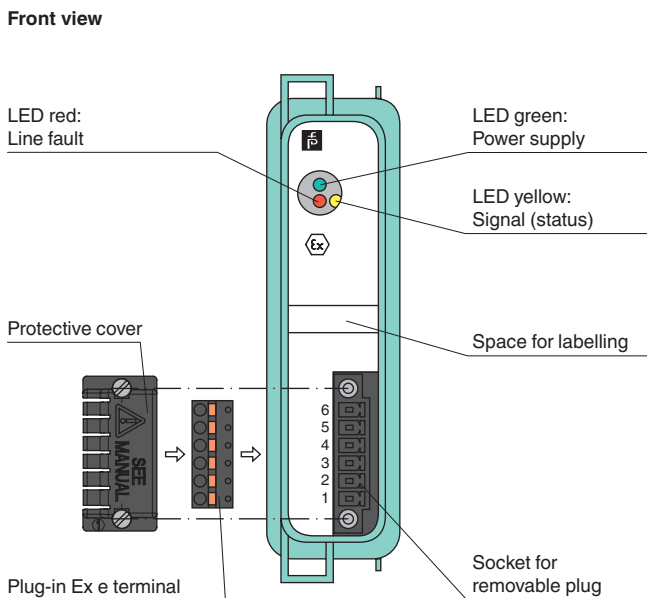

Connection

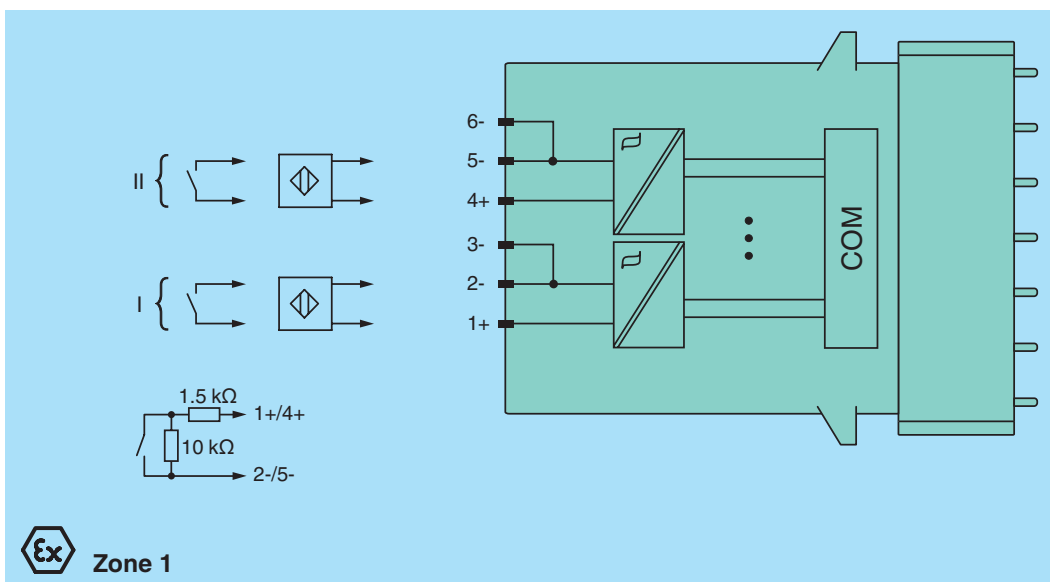

Release date 2018-09-14 10:16 Date of issue 2018-09-14 238482_eng.xml

Slots		
Occupied slots		1
Supply		
Connection		backplane bus
Rated voltage	U_r	12 V DC , only in connection with the power supplies FB92**
Power dissipation		0.65 W
Power consumption		0.65 W
Internal bus		
Connection		backplane bus
Interface		manufacturer-specific bus to standard com unit
Digital input		
Number of channels		2
Sensor interface		
Connection		NAMUR sensor
Connection [2]		volt-free contact
Connection [3]		active binary signal 24 V DC
Connection		channel I: 1+, 2/3-; channel II: 4+, 5/6-
Rated values		acc. to EN 60947-5-6 (NAMUR)
Switching point/switching hysteresis		1.2 ... 2.1 mA / ± 0.2 mA
Internal resistor	R_i	1 kΩ
Line fault detection		can be switched on/off for each channel via configuration tool
Connection		mechanical switch with additional resistors (see connection diagram) proximity switches without additional wiring
Short-circuit		< 360 Ω
Open-circuit		< 0.35 mA
Minimum pulse duration		20 ms
Indicators/settings		
LED indication		LED green: supply LED red: line fault, per channel LED yellow: signal (status), per channel
Coding		optional mechanical coding via front socket
Directive conformity		
Electromagnetic compatibility		
Directive 2014/30/EU		EN 61326-1:2006
Conformity		
Electromagnetic compatibility		NE 21:2007
Degree of protection		IEC 60529:2000
Environmental test		EN 60068-2-14:2009
Shock resistance		EN 60068-2-27:2009
Vibration resistance		EN 60068-2-6:2008
Damaging gas		EN 60068-2-42:2003
Relative humidity		EN 60068-2-78:2001
Ambient conditions		
Ambient temperature		-20 ... 60 °C (-4 ... 140 °F)
Storage temperature		-25 ... 85 °C (-13 ... 185 °F)
Relative humidity		95 % non-condensing
Shock resistance		shock type I, shock duration 11 ms, shock amplitude 15 g, number of shocks 18
Vibration resistance		frequency range 10 ... 150 Hz; transition frequency: 57.56 Hz, amplitude/acceleration ± 0.075 mm/1 g; 10 cycles frequency range 5 ... 100 Hz; transition frequency: 13.2 Hz amplitude/acceleration ± 1 mm/0.7 g; 90 minutes at each resonance
Damaging gas		designed for operation in environmental conditions acc. to ISA-S71.04-1985, severity level G3
Mechanical specifications		
Degree of protection		IP20 (module) , a separate housing is required acc. to the system description
Connection		Ex e spring terminal with protective cover
Mass		approx. 350 g
Dimensions		28 x 107 x 132 mm (1.1 x 4.2 x 5.2 inch)
Data for application in connection with hazardous areas		
EU-Type Examination Certificate		BVS 11 ATEX E 093 X
Marking		Ⓔ II 2 G Ex db eb IIC T4
Galvanic isolation		
Input/power supply, internal bus		safe electrical isolation acc. to EN 60079-11: 2007, voltage peak value 375 V
Directive conformity		

Release date 2018-09-14 10:16 Date of issue 2018-09-14 238482_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Directive 2014/34/EU	EN 60079-0:2009 EN 60079-1:2007 EN 60079-7:2007
International approvals	
ATEX approval	BVS 11 ATEX E 093X
INMETRO	Brazil: TÜV 14.1599X
EAC approval	Russia: RU C-IT.MIII06.B.00129
Marine approval	
Lloyd Register	15/20021
American Bureau of Shipping	T1450280/UN
Bureau Veritas Marine	22449/B0 BV
General information	
System information	The module has to be mounted in appropriate backplanes (FB92**) in Zone 1, 2, or outside hazardous areas. Observe the corresponding EC-type examination certificate.
Supplementary information	EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com .

Release date 2018-09-14 10:16 Date of issue 2018-09-14 238482_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com