

Features

- 8-channel
- Outputs with plug-in Ex e terminals
- Installation in suitable enclosures in Zone 1
- Module can be exchanged under voltage (hot swap)
- Line fault detection (LFD)
- Positive or negative logic selectable
- Simulation mode for service operations (forcing)
- Permanently self-monitoring
- Output with watchdog
- Output with bus-independent safety shutdown input
- Output with bus-independent safety shutdown

Function

The device features 8 independent channels.

The device can be used to drive low power solenoids, sounders, or LEDs.


Open and short circuit line faults are detected.

The device is supplied with plug-in Ex e terminals and protective cover.


The outputs are galvanically isolated from the bus and the power supply.

The outputs can be switched off via a contact. This can be used for bus-independent safety applications.

Assembly

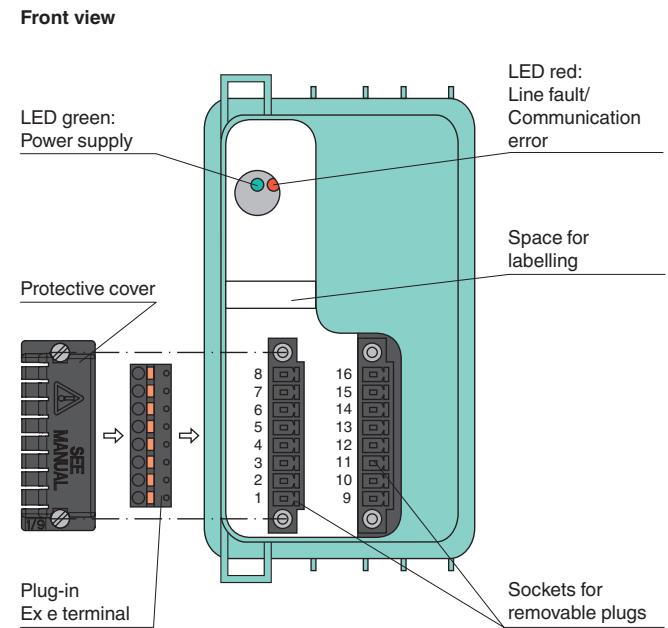


Connection

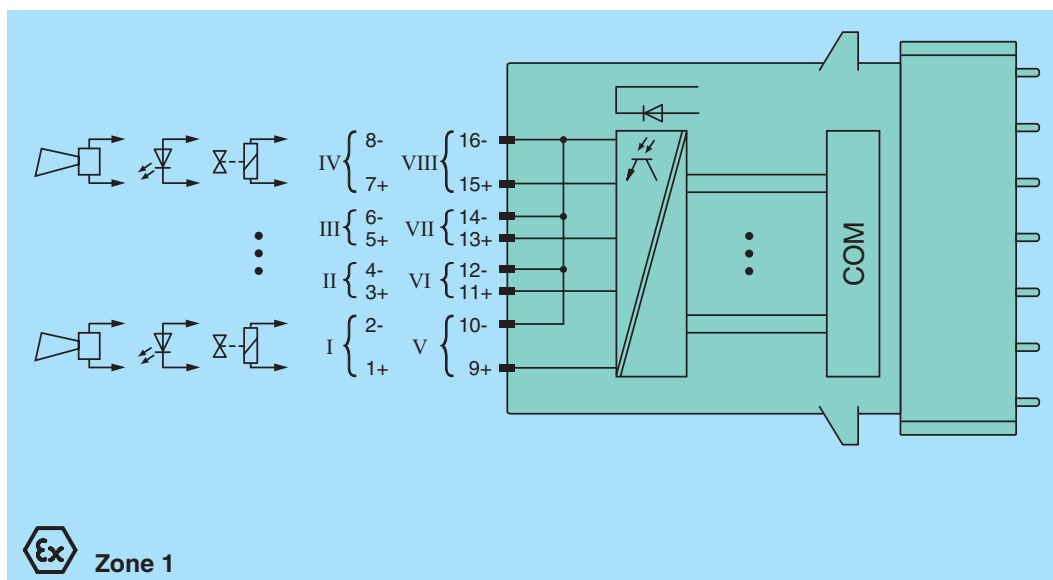

Release date 2018-09-14 09:34 Date of issue 2018-09-14 238527_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Slots		
Occupied slots		2
Supply		
Connection		backplane bus
Rated voltage	U_r	12 V DC , only in connection with the power supplies FB92**
Power dissipation		2.35 W
Power consumption		2.35 W
Internal bus		
Connection		backplane bus
Interface		manufacturer-specific bus to standard com unit
Digital output		
Number of channels		8
Suitable field devices		
Field device		Solenoid Valve
Field device [2]		audible alarm
Field device [3]		visual alarm
Connection		channel I: 1+, 2-; channel II: 3+, 4-; channel III: 5+, 6-; channel IV: 7+, 8-; channel V: 9+, 10-; channel VI: 11+, 12-; channel VII: 13+, 14-; channel VIII: 15+, 16-
Current limit	I_{max}	8 mA
Open loop voltage		20 V
Line fault detection		can be switched on/off for each channel via configuration tool
Test current		0.33 mA
Short-circuit		< 300 Ω
Open-circuit		> 50 k Ω
Response time		20 ms (depending on bus cycle time)
Watchdog		within 0.5 s the device goes in safe state, e.g. after loss of communication
Indicators/settings		
LED indication		LED green: supply LED red: line fault , red flashing: communication error
Coding		optional mechanical coding via front socket
Directive conformity		
Electromagnetic compatibility		
Directive 2014/30/EU		EN 61326-1:2006
Conformity		
Electromagnetic compatibility		NE 21:2007
Degree of protection		IEC 60529:2000
Environmental test		EN 60068-2-14:2009
Shock resistance		EN 60068-2-27:2009
Vibration resistance		EN 60068-2-6:2008
Damaging gas		EN 60068-2-42:2003
Relative humidity		EN 60068-2-78:2001
Ambient conditions		
Ambient temperature		-20 ... 60 °C (-4 ... 140 °F)
Storage temperature		-25 ... 85 °C (-13 ... 185 °F)
Relative humidity		95 % non-condensing
Shock resistance		shock type I, shock duration 11 ms, shock amplitude 15 g, number of shocks 18
Vibration resistance		frequency range 10 ... 150 Hz; transition frequency: 57.56 Hz, amplitude/acceleration \pm 0.075 mm/1 g; 10 cycles frequency range 5 ... 100 Hz; transition frequency: 13.2 Hz amplitude/acceleration \pm 1 mm/0.7 g; 90 minutes at each resonance
Damaging gas		designed for operation in environmental conditions acc. to ISA-S71.04-1985, severity level G3
Mechanical specifications		
Degree of protection		IP20 (module) , a separate housing is required acc. to the system description
Connection		Ex e spring terminal with protective cover
Mass		approx. 750 g
Dimensions		57 x 107 x 132 mm (2.2 x 4.2 x 5.2 inch)
Data for application in connection with hazardous areas		
EU-Type Examination Certificate		BVS 11 ATEX E 093 X
Marking		 II 2 G Ex db eb IIC T4
Galvanic isolation		
Output/power supply, internal bus		safe electrical isolation acc. to EN 60079-11:2007 , voltage peak value 375 V
Directive conformity		
Directive 2014/34/EU		EN 60079-0:2009 EN 60079-1:2007 EN 60079-7:2007

Release date 2018-09-14 09:34 Date of issue 2018-09-14 238527_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

International approvals	
ATEX approval	BVS 11 ATEX E 093X
INMETRO	Brazil: TÜV 14.1599X
Marine approval	
Bureau Veritas Marine	22449/B0 BV
General information	
System information	The module has to be mounted in appropriate backplanes (FB92**) in Zone 1, 2, or outside hazardous areas. Observe the corresponding EC-type examination certificate.
Supplementary information	EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com .

Release date 2018-09-14 09:34 Date of issue 2018-09-14 238527_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com