

Features

- 1-channel
- Converter for thermocouples and mV-signals
- Installation in Zone 2 or safe area
- Simulation mode for service operations (forcing)
- Line fault detection (LFD)
- Permanently self-monitoring
- Module can be exchanged under voltage


Function

The mV input accepts thermocouple or mV signals from the hazardous area.


Open circuit line fault alarms are detected.

The input is galvanically isolated from the bus and the power supply (EN 60079-11).

Assembly

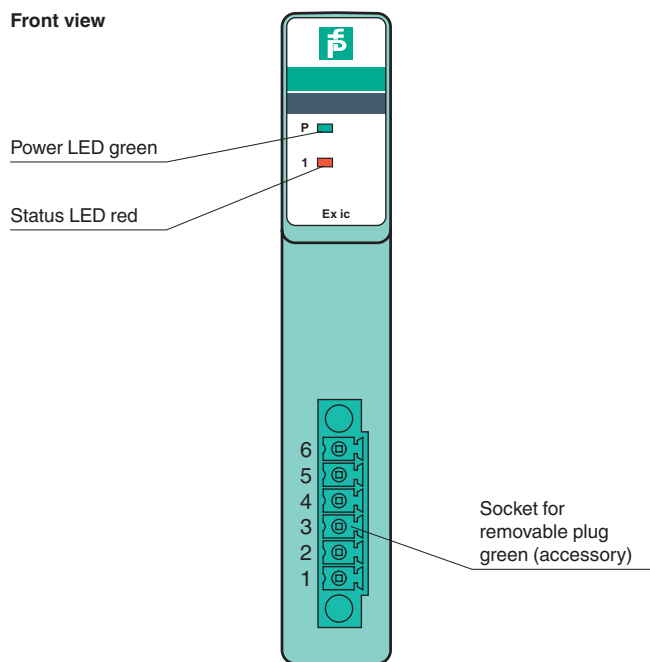

Connection

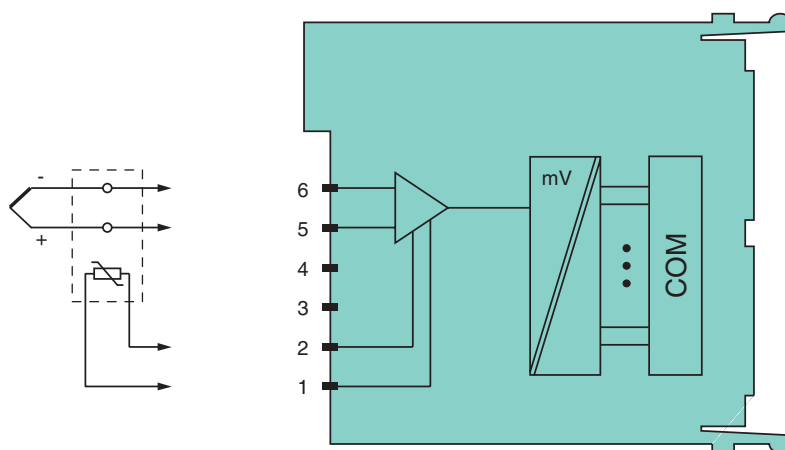

Zone 2

Release date 2018-09-13 14:53 Date of issue 2018-09-13 254739_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com

Slots	
Occupied slots	1
Supply	
Connection	backplane bus
Rated voltage U_r	12 V DC , only in connection with the power supplies LB9***
Power dissipation	0.45 W
Power consumption	0.45 W
Internal bus	
Connection	backplane bus
Interface	manufacturer-specific bus to standard com unit
Input	
Compensation (reference junction CJC)	internal cold junction compensation or external cold junction
temperature input	
Number of channels	1
Suitable field devices	
Field device [2]	Thermocouple
Field device [4]	mV source
Suitable sensors	
Sensor	thermocouples U, B, E, T, K, S, R, L, J, N, Pallaplat and mV sources
Connection	cold junction: 1, 2 thermocouple: 5+, 6-
Measurement range	-75 ... mV ... 75 mV
Smallest span	5 mV for 0.1 % accuracy
Linearity error	0.1 %
Conversion time	internal cold junction: max. 120 ms without LFD max. 240 ms with LFD external cold junction: max. 20 ms without LFD max. 80 ms with LFD
Compensation (reference junction CJC)	internal cold junction compensation or external cold junction
Line fault detection	can be switched on/off for each channel via configuration tool ,
Open-circuit	> 1 k Ω
Transfer characteristics	
Deviation	
Influence of ambient temperature	max. 0,1 %/10 K
Indicators/settings	
LED indication	Power LED (P) green: supply Status LED (1) red: line fault
Coding	optional mechanical coding via front socket
Directive conformity	
Electromagnetic compatibility	
Directive 2014/30/EU	EN 61326-1
Conformity	
Electromagnetic compatibility	
Degree of protection	IEC 60529
Environmental test	EN 60068-2-14
Shock resistance	EN 60068-2-27
Vibration resistance	EN 60068-2-6
Damaging gas	EN 60068-2-42
Relative humidity	EN 60068-2-56
Ambient conditions	
Ambient temperature	-20 ... 60 °C (-4 ... 140 °F) , 70 °C (non-Ex)
Storage temperature	-25 ... 85 °C (-13 ... 185 °F)
Relative humidity	95 % non-condensing
Shock resistance	shock type I, shock duration 11 ms, shock amplitude 15 g, number of shocks 18
Vibration resistance	frequency range 10 ... 150 Hz; transition frequency: 57.56 Hz, amplitude/acceleration \pm 0.075 mm/1 g; 10 cycles frequency range 5 ... 100 Hz; transition frequency: 13.2 Hz amplitude/acceleration \pm 1 mm/0.7 g; 90 minutes at each resonance
Damaging gas	designed for operation in environmental conditions acc. to ISA-S71.04-1985, severity level G3
Mechanical specifications	
Degree of protection	IP20 when mounted on backplane
Connection	removable front connector with screw flange (accessory) wiring connection via spring terminals (0.14 ... 1.5 mm ²) or screw terminals (0.08 ... 1.5 mm ²)
Mass	approx. 90 g
Dimensions	16 x 100 x 102 mm (0.63 x 3.9 x 4 inch)

Release date 2018-09-13 14:53 Date of issue 2018-09-13 254739_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com

Data for application in connection with hazardous areas	
Certificate	PF 08 CERT 1234 X
Marking	⊕ II 3 G Ex nA [ic] IIC T4 Gc
Galvanic isolation	
Input/power supply, internal bus	safe electrical isolation acc. to EN 60079-11, voltage peak value 375 V
Directive conformity	
Directive 2014/34/EU	EN 60079-0:2009 EN 60079-11:2007 EN 60079-15:2010
International approvals	
IECEx approval	BVS 09.0037X
Approved for	Ex nA [ic] IIC T4 Gc
Marine approval	
Lloyd Register	15/20021
DNV GL Marine	TAA0000034
Bureau Veritas Marine	22449/B0 BV
General information	
System information	The module has to be mounted in appropriate backplanes (LB9***) in Zone 2 or outside hazardous areas. Here, observe the corresponding declaration of conformity. For use in hazardous areas (e. g. Zone 2 or Zone 22) the module must be installed in an appropriate enclosure.
Supplementary information	EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com .

Release date 2018-09-13 14:53 Date of issue 2018-09-13 254739_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com