

Features

- 1-channel
- Input Ex ia
- Mounting in Zone 2, Class I/Div.2 or in the safe area
- Converter for thermocouples and mV-signals
- Simulation mode for service operations (forcing)
- Line fault detection (LFD)
- Permanently self-monitoring
- Module can be exchanged under voltage

Function


The mV input accepts thermocouple or mV signals from the hazardous area.

Open circuit line fault alarms are detected.



The intrinsically safe input is galvanically isolated from the bus and the power supply (EN 60079-11).

Assembly

Front view

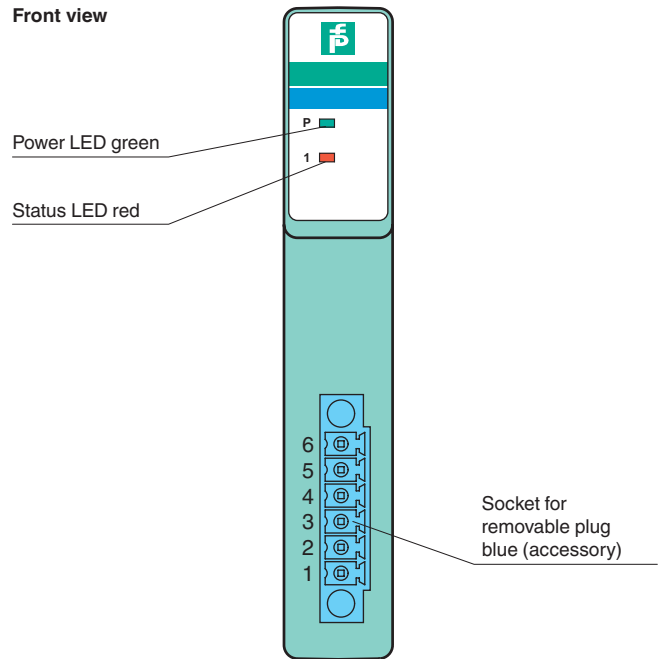

Connection

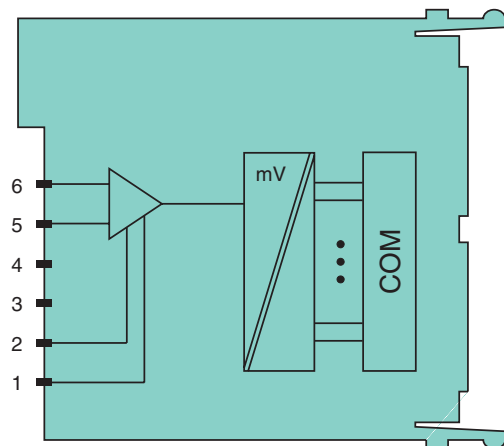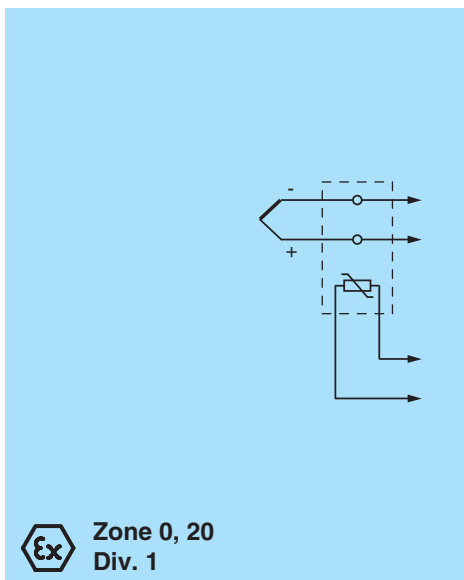

**Zone 2
Div. 2**

Release date 2018-11-06 09:50 Date of issue 2018-11-06 254808_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com




Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com

Slots	
Occupied slots	1
Supply	
Connection	backplane bus
Rated voltage U_r	12 V DC , only in connection with the power supplies LB9***
Power dissipation	0.45 W
Power consumption	0.45 W
Internal bus	
Connection	backplane bus
Interface	manufacturer-specific bus to standard com unit
Input	
Compensation (reference junction CJC)	internal cold junction compensation or external cold junction
temperature input	
Number of channels	1
Suitable field devices	
Field device [2]	Thermocouple
Field device [4]	mV source
Suitable sensors	
Sensor	thermocouples U, B, E, T, K, S, R, L, J, N, Pallaplat and mV sources
Connection	cold junction: 1, 2 thermocouple: 5+, 6-
Measurement range	-75 ... mV ... 75 mV
Smallest span	5 mV for 0.1 % accuracy
Linearity error	0.1 %
Conversion time	internal cold junction: max. 120 ms without LFD max. 240 ms with LFD external cold junction: max. 20 ms without LFD max. 80 ms with LFD
Compensation (reference junction CJC)	internal cold junction compensation or external cold junction
Line fault detection	can be switched on/off for each channel via configuration tool ,
Open-circuit	> 1 k Ω
Transfer characteristics	
Deviation	
Influence of ambient temperature	max. 0,1 %/10 K
Indicators/settings	
LED indication	Power LED (P) green: supply Status LED (1) red: line fault
Coding	optional mechanical coding via front socket
Directive conformity	
Electromagnetic compatibility	
Directive 2014/30/EU	EN 61326-1
Conformity	
Electromagnetic compatibility	
Degree of protection	NE 21
Environmental test	IEC 60529
Shock resistance	EN 60068-2-14
Vibration resistance	EN 60068-2-27
Damaging gas	EN 60068-2-6
Relative humidity	EN 60068-2-42
Ambient conditions	
Ambient temperature	-20 ... 60 °C (-4 ... 140 °F)
Storage temperature	-25 ... 85 °C (-13 ... 185 °F)
Relative humidity	95 % non-condensing
Shock resistance	shock type I, shock duration 11 ms, shock amplitude 15 g, number of shocks 18
Vibration resistance	frequency range 10 ... 150 Hz; transition frequency: 57.56 Hz, amplitude/acceleration \pm 0.075 mm/1 g; 10 cycles frequency range 5 ... 100 Hz; transition frequency: 13.2 Hz amplitude/acceleration \pm 1 mm/0.7 g; 90 minutes at each resonance
Damaging gas	designed for operation in environmental conditions acc. to ISA-S71.04-1985, severity level G3
Mechanical specifications	
Degree of protection	IP20 when mounted on backplane
Connection	removable front connector with screw flange (accessory) wiring connection via spring terminals (0.14 ... 1.5 mm ²) or screw terminals (0.08 ... 1.5 mm ²)
Mass	approx. 90 g
Dimensions	16 x 100 x 102 mm (0.63 x 3.9 x 4 inch)

Release date 2018-11-06 09:50 Date of issue 2018-11-06 254808_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Data for application in connection with hazardous areas		
EU-Type Examination Certificate		PTB 03 ATEX 2042
Marking		 
Input		
Voltage	U_o	1.8 V
Current	I_o	43 mA
Power	P_o	67 mW (trapezoid characteristic curve)
Certificate		PF 08 CERT 1234 X
Marking		
Galvanic isolation		
Input/power supply, internal bus		safe electrical isolation acc. to EN 60079-11, voltage peak value 375 V
Directive conformity		
Directive 2014/34/EU		EN 60079-0:2009 EN 60079-11:2007 EN 60079-15:2010 EN 61241-11:2006
International approvals		
ATEX approval		PTB 03 ATEX 2042
UL approval		E106378
Control drawing		116-0322
IECEx approval		BVS 09.0037X
Approved for		Ex nA [ja Ga] IIC T4 Gc [Ex ia Da] IIIC
Marine approval		
Lloyd Register		15/20021
DNV GL Marine		TAA0000034
Bureau Veritas Marine		22449/B0 BV
General information		
System information		The module has to be mounted in appropriate backplanes (LB9***) in Zone 2 or outside hazardous areas. Here, observe the corresponding declaration of conformity. For use in hazardous areas (e. g. Zone 2, Zone 22 or Div. 2) the module must be installed in an appropriate enclosure.
Supplementary information		EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com .

Release date 2018-11-06 09:50 Date of issue 2018-11-06 254808_eng.xml