

Features

- 1-channel
- Input Ex ia
- Mounting in Zone 2, Class I/Div.2 or in the safe area
- Input 0 V ... 10 V
- Simulation mode for service operations (forcing)
- Permanently self-monitoring
- Module can be exchanged under voltage


Function

The voltage converter accepts signals from the hazardous area.



The intrinsically safe input is galvanically isolated from the bus and the power supply (EN 60079-11).

Assembly

Front view

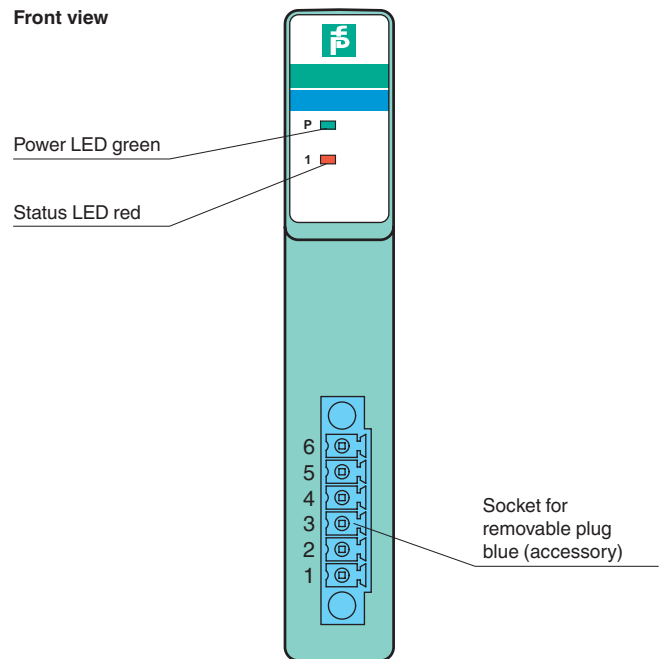

Connection

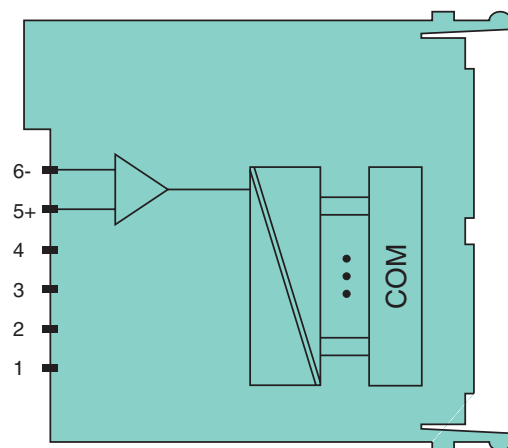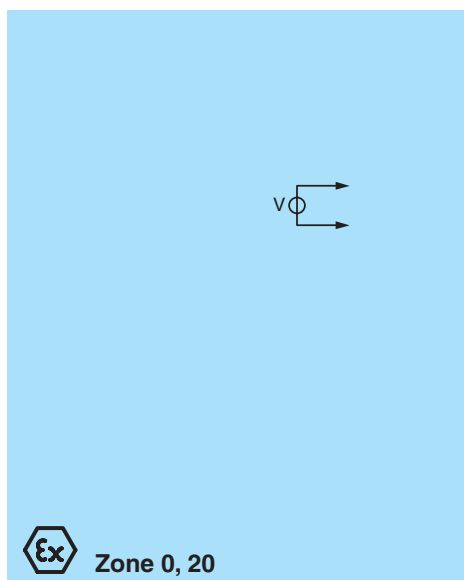

Zone 2
Div. 2

| | | |
|--|-------|--|
| Slots | | |
| Occupied slots | | 1 |
| Supply | | |
| Connection | | backplane bus |
| Rated voltage | U_r | 12 V DC , only in connection with the power supplies LB9*** |
| Power dissipation | | 0.4 W |
| Power consumption | | 0.4 W |
| Internal bus | | |
| Connection | | backplane bus |
| Interface | | manufacturer-specific bus to standard com unit |
| Analog input | | |
| Number of channels | | 1 |
| Suitable field devices | | |
| Field device | | voltage input |
| Connection | | voltage input: 5+, 6- |
| Measurement range | | 0 ... 10 V |
| Smallest span | | 500 mV |
| Linearity error | | 0.1 % |
| Input resistance | | 100 k Ω |
| Conversion time | | \leq 100 ms |
| Transfer characteristics | | |
| Deviation | | |
| Influence of ambient temperature | | max. 0,1 %/10 K |
| Indicators/settings | | |
| LED indication | | Power LED (P) green: supply Status LED (1) red: line fault |
| Coding | | optional mechanical coding via front socket |
| Directive conformity | | |
| Electromagnetic compatibility | | |
| Directive 2014/30/EU | | EN 61326-1 |
| Conformity | | |
| Electromagnetic compatibility | | |
| Degree of protection | | IEC 60529 |
| Environmental test | | EN 60068-2-14 |
| Shock resistance | | EN 60068-2-27 |
| Vibration resistance | | EN 60068-2-6 |
| Damaging gas | | EN 60068-2-42 |
| Relative humidity | | EN 60068-2-56 |
| Ambient conditions | | |
| Ambient temperature | | -20 ... 60 °C (-4 ... 140 °F) |
| Storage temperature | | -25 ... 85 °C (-13 ... 185 °F) |
| Relative humidity | | 95 % non-condensing |
| Shock resistance | | shock type I, shock duration 11 ms, shock amplitude 15 g, number of shocks 18 |
| Vibration resistance | | frequency range 10 ... 150 Hz; transition frequency: 57.56 Hz, amplitude/acceleration \pm 0.075 mm/1 g; 10 cycles frequency range 5 ... 100 Hz; transition frequency: 13.2 Hz amplitude/acceleration \pm 1 mm/0.7 g; 90 minutes at each resonance |
| Damaging gas | | designed for operation in environmental conditions acc. to ISA-S71.04-1985, severity level G3 |
| Mechanical specifications | | |
| Degree of protection | | IP20 when mounted on backplane |
| Connection | | removable front connector with screw flange (accessory) wiring connection via spring terminals (0.14 ... 1.5 mm ²) or screw terminals (0.08 ... 1.5 mm ²) |
| Mass | | approx. 90 g |
| Dimensions | | 16 x 100 x 102 mm (0.63 x 3.9 x 4 inch) |
| Data for application in connection with hazardous areas | | |
| EU-Type Examination Certificate | | |
| Marking | | Ⓔ II (1) G [Ex ia] IIC Ⓔ II (1) D [Ex ia] IIIC |
| Input | | |
| Voltage | U_o | 0.9 V |
| Current | I_o | 0.2 mA |
| Power | P_o | 0.2 mW (linear characteristic) |
| Certificate | | |
| Marking | | Ⓔ II 3 G Ex nA IIC T4 Gc |
| Galvanic isolation | | |

Release date 2018-09-13 16:18 Date of issue 2018-09-13 254816_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

| | |
|----------------------------------|---|
| Input/power supply, internal bus | safe electrical isolation acc. to EN 60079-11, voltage peak value 375 V |
| Directive conformity | |
| Directive 2014/34/EU | EN 60079-0:2009 EN 60079-11:2007 EN 60079-15:2010 EN 61241-11:2006 |
| International approvals | |
| ATEX approval | PTB 03 ATEX 2042 |
| UL approval | E106378 |
| Control drawing | 116-0322 |
| IECEx approval | BVS 09.0037X |
| Approved for | Ex nA [ia Ga] IIC T4 Gc [Ex ia Da] IIIC |
| Marine approval | |
| Lloyd Register | 15/20021 |
| DNV GL Marine | TAA0000034 |
| Bureau Veritas Marine | 22449/B0 BV |
| General information | |
| System information | The module has to be mounted in appropriate backplanes (LB9***) in Zone 2 or outside hazardous areas. Here, observe the corresponding declaration of conformity. For use in hazardous areas (e. g. Zone 2, Zone 22 or Div. 2) the module must be installed in an appropriate enclosure. |
| Supplementary information | EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com . |

Release date 2018-09-13 16:18 Date of issue 2018-09-13 254816_eng.xml