

**Features**

- 2-channel isolated barrier
- 24 V DC supply (bus or loop powered)
- Output 40 mA at 12 V DC, 55 mA current limit
- Contact or logic control input
- Entity parameter  $I_O/I_{SC} = 110$  mA
- Line fault detection (LFD)
- Up to SIL 2 acc. to IEC 61508 (bus powered)
- Up to SIL 3 acc. to IEC 61508 (loop powered)

**Function**

This isolated barrier is used for intrinsic safety applications. It supplies power to solenoids, LEDs, and audible alarms, located in a hazardous area.

It is controlled with a loop-powered control signal, switch contact, transistor, or logic signal.


At full load, 12 V at 40 mA (with 55 mA current limit) is available for the hazardous area application.

An alternative low current output is available for driving a single LED without installing an external current limiting resistor.


Line fault detection of the field circuit is indicated by a red LED and an output on the fault bus.

This device mounts on a HiD Termination Board.

**Assembly**

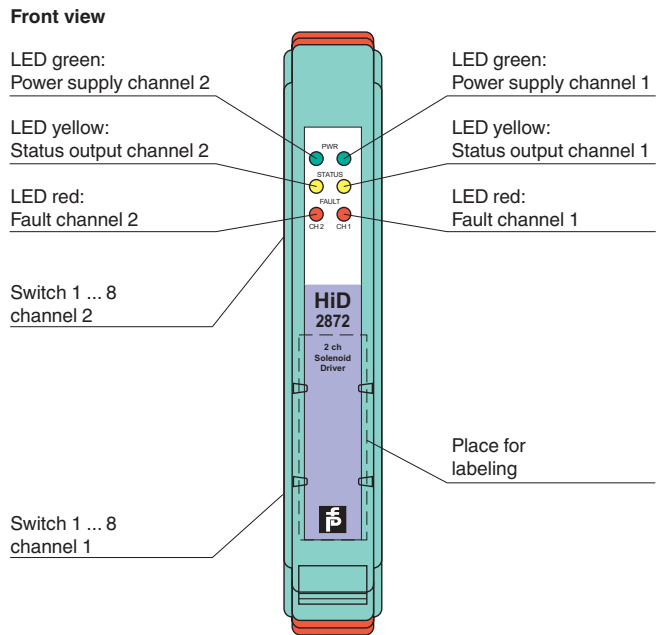

**Connection**

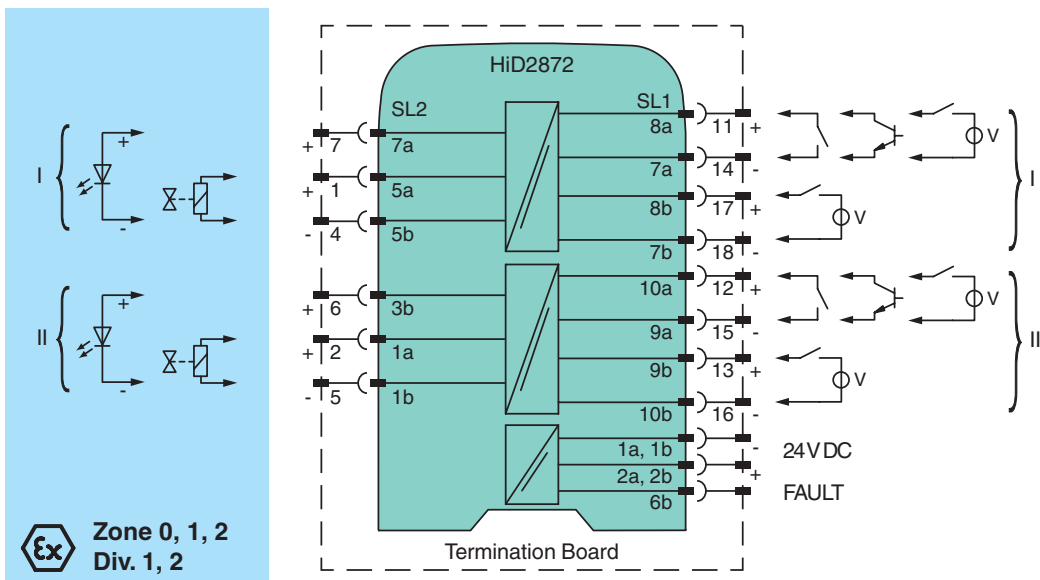

Release date 2018-04-09 08:53 Date of issue 2018-04-09 278766\_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

<b>General specifications</b>		
Signal type		Digital Output
<b>Functional safety related parameters</b>		
Safety Integrity Level (SIL)		SIL 3
<b>Supply</b>		
Connection		SL1: 1a(-), 1b(-); 2a(+), 2b(+)
Rated voltage	$U_r$	20.4 ... 30 V DC loop powered 20.4 ... 30 V DC bus powered via Termination Board
Input current		62 mA at 24 V, 300 $\Omega$ load (per channel)
Power dissipation		1 W at 24 V, 300 $\Omega$ load (per channel)
<b>Input</b>		
Connection side		control side
Connection		SL1: 8a(+), 7a(-); 10a(+), 9a(-) bus powered SL1: 8b(+), 7b(-); 9b(+), 10b(-) loop powered
Control input		external switch (dry contact or open collector) non isolated or logic signal input fully floating
Signal level		1-signal: 15...30 V DC (current limited at 3 mA) or contact close (internal 10 k $\Omega$ pull-up) 0-signal: 0...5 V DC or contact open
Power dissipation		1 W at 24 V, 300 $\Omega$ load (per channel) for loop powered
Inrush current		0.2 A, 15 ms loop powered
<b>Output</b>		
Connection side		field side
Connection		SL2: 5a(+), 5b(-), 7a(+); 1a(+), 1b(-), 3b(+)
Internal resistor	$R_i$	approx. 240 $\Omega$
Current	$I_e$	$\leq 40$ mA
Voltage	$U_e$	$\geq 12$ V
Current limit	$I_{max}$	55 mA
Open loop voltage	$U_s$	approx. 22.5 V
Load		nominal 0.1 ... 5 k $\Omega$
Switching frequency	f	- bus powered: filter OFF: max. 150 Hz, filter ON: max. 15 Hz - loop powered: max. 10 Hz
Energized/De-energized delay		- bus powered: filter OFF: 1 ms, filter ON: 10 ms - loop powered: switch-on 50 ms, switch-off 6 ms (300 $\Omega$ load)
<b>Fault indication output</b>		
Connection		SL1: 6b
Output type		open collector transistor (internal fault bus)
Fault current		4 mA pulsing (20 ms ON, 200 ms OFF)
Fault level		lead short-circuit detection at $< 25 \Omega$ lead breakage detection at $> 100 \text{ k}\Omega$ typical
<b>Galvanic isolation</b>		
Output/Output		safe electrical isolation acc. to EN 60079-11: 2007, voltage peak value 60 V
Output/power supply, inputs, and collective error		safe electrical isolation acc. to EN 60079-11: 2007, voltage peak value 375 V
<b>Indicators/settings</b>		
Display elements		LEDs
Control elements		DIP-switch
Configuration		via DIP switches
Labeling		space for labeling at the front
<b>Directive conformity</b>		
Electromagnetic compatibility		
Directive 2014/30/EU		EN 61326-1:2013 (industrial locations)
<b>Conformity</b>		
Electromagnetic compatibility		NE 21:2006 For further information see system description.
Degree of protection		IEC 60529:2001
<b>Ambient conditions</b>		
Ambient temperature		-20 ... 60 $^{\circ}\text{C}$ (-4 ... 140 $^{\circ}\text{F}$ )
Relative humidity		5 ... 90 %, non-condensing up to 35 $^{\circ}\text{C}$ (95 $^{\circ}\text{F}$ )
<b>Mechanical specifications</b>		
Degree of protection		IP20
Mass		approx. 140 g
Dimensions		18 x 106 x 128 mm (0.7 x 4.2 x 5 inch)
Mounting		on Termination Board
Coding		pin 1 and 4 trimmed For further information see system description.
<b>Data for application in connection with hazardous areas</b>		

Release date 2018-04-09 08:53 Date of issue 2018-04-09 278766\_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group  
www.pepperl-fuchs.com


USA: +1 330 486 0002  
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222  
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091  
pa-info@sg.pepperl-fuchs.com

EU-Type Examination Certificate	CESI 10 ATEX 036	
Marking	$\text{Ex}$ II (1)G [Ex ia Ga] IIC $\text{Ex}$ II (1)D [Ex ia Da] IIIC $\text{Ex}$ I (M1) [Ex ia Ma] I	
Output	Ex ia Ga, Ex ia Da, Ex ia Ma	
Voltage	$U_o$	26 V
Current	$I_o$	110 mA
Power	$P_o$	715 mW
Supply		
Maximum safe voltage	$U_m$	253 V AC (Attention! $U_m$ is no rated voltage.)
Certificate	PF 10 CERT 1729 X	
Marking	$\text{Ex}$ II 3G Ex nA IIC T4 Gc	
Directive conformity		
Directive 2014/34/EU	EN 60079-0:2012+A11:2013 , EN 60079-11:2012 , EN 60079-15:2010	
International approvals		
CSA approval		
Control drawing	366-005CS-12B (cCSAus)	
IECEX approval	IECEX CES 10.0013	
General information		
Supplementary information	Observe the certificates, declarations of conformity, instruction manuals, and manuals where applicable. For information see <a href="http://www.pepperl-fuchs.com">www.pepperl-fuchs.com</a> .	

### Configuration

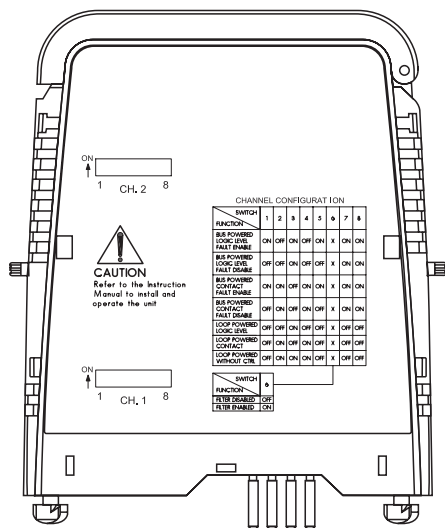

### Switch settings

Switches for channel I and II	S1	S2	S3	S4	S5	S6	S7	S8
<b>Function</b>								
• Bus powered • Control input: logic signal • Line fault detection enabled	ON	OFF	ON	OFF	ON	X	ON	ON
• Bus powered • Control input: logic signal • Line fault detection disabled	OFF	OFF	ON	OFF	OFF	X	ON	ON
• Bus powered • Control input: contact • Line fault detection enabled	ON	ON	OFF	ON	ON	X	ON	ON
• Bus powered • Control input: contact • Line fault detection disabled	OFF	ON	OFF	ON	OFF	X	ON	ON
• Loop powered • Control input: logic signal • Line fault detection disabled	OFF	OFF	ON	OFF	OFF	X	OFF	OFF
• Loop powered • Control input: contact • Line fault detection disabled	OFF	ON	OFF	ON	OFF	X	OFF	OFF
• Loop powered • Control input: without control • Line fault detection disabled	OFF	ON	ON	ON	OFF	X	OFF	OFF
<b>Switches for channel I and II</b>	<b>S6</b>							
<b>Function</b>								
Filter disable	OFF							
Filter enable	ON							

Factory settings: bus powered, control input: contact, line fault detection enabled, filter disabled



To reduce the power consumption of the device, we recommend to set the DIP switches of channel II in the OFF condition, when channel II is not used (single channel application).

The new device HiD2872 will replace the devices HiD2871, HiD2872, HiD2873 and HiD2874. The new device HiD2872 has the same device functions as the four previous devices. If you want to use the specific device functions of the previous devices, you must configure the new device HiD2872. See following table.

Release date 2018-04-09 08:53 Date of issue 2018-04-09 278766\_eng.xml

Previous device				New device									
HiD2871, part number 121464 HiD2872, part number 121471				HiD2872, part number 204846									
Settings	S1	S2	S3	Settings	S1	S2	S3	S4	S5	S6	S7	S8	
Bus powered with control	OFF	ON	ON	<ul style="list-style-type: none"> <li>Bus powered</li> <li>Control input: contact</li> <li>Line fault detection disable</li> </ul>	OFF	ON	OFF	ON	OFF	X	ON	ON	
Loop powered	ON	OFF	OFF	<ul style="list-style-type: none"> <li>Loop powered</li> <li>Control input: without control</li> </ul>	OFF	ON	ON	ON	OFF	X	OFF	OFF	
Loop powered with control	OFF	OFF	OFF										
HiD2873, part number 121502 HiD2874, part number 121505				HiD2872, part number 204846									
Settings	S1	S2	S3	Settings	S1	S2	S3	S4	S5	S6	S7	S8	
Contact or open collector	OFF	ON	ON	<ul style="list-style-type: none"> <li>Bus powered</li> <li>Control input: contact</li> <li>Line fault detection disable</li> </ul>	OFF	ON	OFF	ON	OFF	X	ON	ON	
Logic input	ON	OFF	OFF	<ul style="list-style-type: none"> <li>Bus powered</li> <li>Control input: logic signal</li> <li>Line fault detection disable</li> </ul>	OFF	OFF	ON	OFF	OFF	X	ON	ON	

Configure the device in the following way:

- Push the red Quick Lok Bars on each side of the device in the upper position.
- Remove the device from Termination Board.
- Set the DIP switches according to the figure.




*The pins for this device are trimmed to polarize it according to its safety parameter. Do not change! For further information see system description.*



*When both channels of the solenoid driver are operated in normally energised condition, either the load must be reduced or increased spacing/ventilation be applied to reduce the temperature rise. Contact Pepperl+Fuchs for guidance.*

### Output characteristics

Output circuit diagram



Output characteristic

