

Features

- Yokogawa Centum 3000 CS AAI835 replacement FTA
- 32 channels of I/O
- 16 channels AI and 16 channels AO
- 2- or 3-wire or self powered transmitters or valves
- Short-circuit protected
- Plug-n-play wiring capabilities

Assembly

Function

The Termination Board designed for easy HiDMux2700 Multiplexer integration with the Yokogawa Centum 3000 CS system.


With the Multiplexer integrated into the board and plug-n-play option for the DCS equipment, this provides a very clean access to the HART signals, while reducing the need for marshalling cabinets and reducing equipment that require extra cabinet space.

The HART Termination Board provides a robust solution for on-line HART communications, interfaces up to 32 field located HART devices, and, it allows the user to replace standard DCS field termination panels.



Connection

Release date 2014-11-17 12:07 Date of issue 2014-11-17 907237_eng.xml

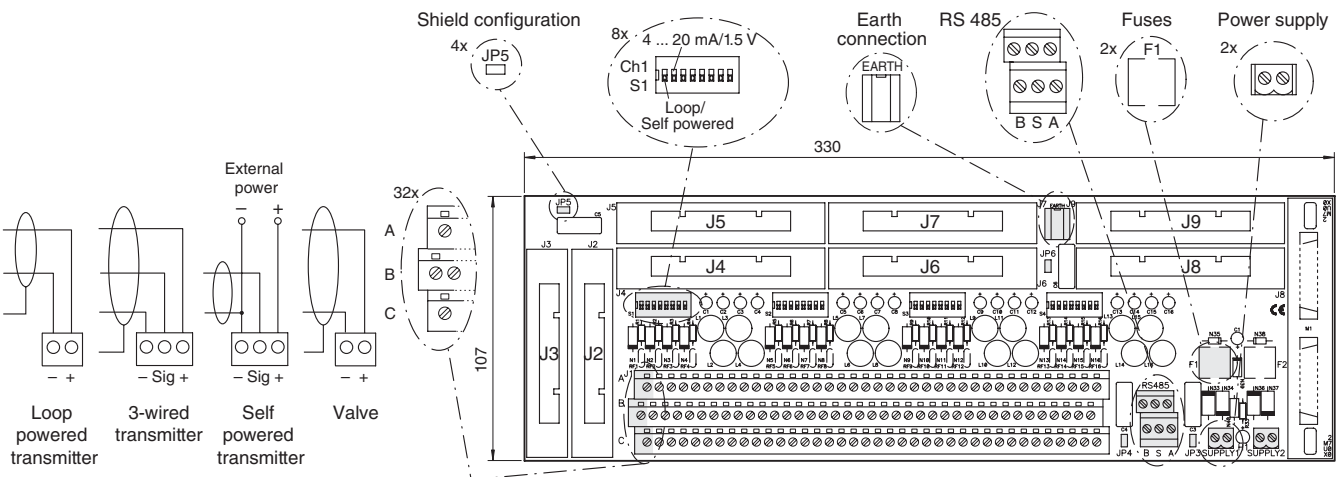

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com



Supply		
Rated voltage	U _N	20 ... 30 V DC
Fusing		3.15 A , 5 x 20 mm (0.2 x 0.8 in)
Power loss		0.7 W , with Multiplexer
Reverse polarity protection		no
HART signal channels (intrinsically safe)		
HART signal channels		
Number of channels		32 unbalanced signal loops
Redundancy		
Supply		no
Electrical isolation		
HART signal channels		30 V DC
Ambient conditions		
Ambient temperature		0 ... 55 °C (32 ... 131 °F)
Relative humidity		5 ... 90 %, non-condensing
Mechanical specifications		
Core cross-section		2.5 mm ² (16 AWG)
Connection		field side: screw terminals control side: KS connector (proprietary) RS 485 interface: removable screw terminals power: removable screw terminals
Mass		approx. 500 g
Dimensions		without HiDMux2700: 330 x 107 x 79 mm (12.9 x 4.2 x 3.1 in) with HiDMux2700: 330 x 107 x 208 mm (12.9 x 4.2 x 8.2 in)
Mounting		DIN rail mounting
General information		
Supplementary information		Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com .

Connections

Connector	Channels
J1	Channel 1 ... 32
J2	Channel 1 ... 8, primary
J3	Channel 1 ... 8, secondary
J4	Channel 9 ... 16, primary
J5	Channel 9 ... 16, secondary
J6	Channel 17 ... 24, primary
J7	Channel 17 ... 24, secondary
J8	Channel 25 ... 32, primary
J9	Channel 25 ... 32, secondary

Configuration

		Switch	Field and DCS have the same signal (4 mA ... 20 mA or 1 V ... 5 V)	Convert a 4 mA ... 20 mA signal from the field into the 1 V ... 5 V signal for DCS	Switch	Self powered device	Loop powered device
S1	Channel 1	1	Off	On	2	Off	On
	Channel 2	3	Off	On	4	Off	On
	Channel 3	5	Off	On	6	Off	On
	Channel 4	7	Off	On	8	Off	On
S2	Channel 5	1	Off	On	2	Off	On
	Channel 6	3	Off	On	4	Off	On
	Channel 7	5	Off	On	6	Off	On
	Channel 8	7	Off	On	8	Off	On
S3	Channel 9	1	Off	On	2	Off	On
	Channel 10	3	Off	On	4	Off	On
	Channel 11	5	Off	On	6	Off	On
	Channel 12	7	Off	On	8	Off	On
S4	Channel 13	1	Off	On	2	Off	On
	Channel 14	3	Off	On	4	Off	On
	Channel 15	5	Off	On	6	Off	On
	Channel 16	7	Off	On	8	Off	On
S5	Channel 17	1	Off	On	2	Off	On
	Channel 18	3	Off	On	4	Off	On
	Channel 19	5	Off	On	6	Off	On
	Channel 20	7	Off	On	8	Off	On
S6	Channel 21	1	Off	On	2	Off	On
	Channel 22	3	Off	On	4	Off	On
	Channel 23	5	Off	On	6	Off	On
	Channel 24	7	Off	On	8	Off	On
S7	Channel 25	1	Off	On	2	Off	On
	Channel 26	3	Off	On	4	Off	On
	Channel 27	5	Off	On	6	Off	On
	Channel 28	7	Off	On	8	Off	On
S8	Channel 29	1	Off	On	2	Off	On
	Channel 30	3	Off	On	4	Off	On
	Channel 31	5	Off	On	6	Off	On
	Channel 32	7	Off	On	8	Off	On

Jumper	Analog input	Galvanic grounding	Capacitive grounding
JP3	RS 485	closed	opened
JP4	Field side channels 1 ... 32	closed	opened
JP5	DCS side channels 1 ... 16	closed	opened
JP6	DCS side channels 17 ... 32	closed	opened

Yokogawa I/O interface

- AAI835

Release date 2014-11-17 12:07 Date of issue 2014-11-17 907237_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".