

Datasheet - AES 1136-2185



Guard door monitors and Safety control modules for Emergency Stop applications / Micro Processor based safety controllers (Series AES) / AES 113x



- Monitoring of BNS range magnetic safety sensors
- 1 safety contact, STOP 0
- 2 Signalling outputs


(Minor differences between the printed image and the original product may exist!)

Ordering details

Product type description	AES 1136-2185
Article number	101172221
EAN Code	4030661300450
eCl@ss	27-37-19-01

Approval


Approval



Classification

Standards	EN ISO 13849-1, IEC 61508
PL	up d
Control category	up 3
PFH value	1.0 x 10 ⁻⁷ /h
SIL	up 2
Mission time	20 Years

Global Properties

Permanent light	AES 113x
Standards	IEC/EN 60204-1, IEC 60947-5-3, IEC 61508, BG-GS-ET-14, BG-GS-ET-20
Compliance with the Directives (Y/N) 	Yes
Climatic stress	EN 60068-2-3, BG-GS-ET-14
Mounting	snaps onto standard DIN rail to EN 60715
Terminal designations	IEC/EN 60947-1
Materials	
- Material of the housings	Plastic, glass-fibre reinforced thermoplastic, ventilated
- Material of the contacts	Ag-Ni, 0,2 µm gold flashed
Weight	190
Start conditions	Automatic
Start input (Y/N)	No
Feedback circuit (Y/N)	No
Start-up test (Y/N)	Yes
Reset after disconnection of supply voltage (Y/N)	No
Automatic reset function (Y/N)	Yes
Reset with edge detection (Y/N)	No
Pull-in delay	
- ON delay with automatic start	adjustable 0,1 / 1.0 s
Drop-out delay	
- Drop-out delay in case of emergency stop	< 50

Mechanical data

Connection type	Screw connection
Cable section	
- Min. Cable section	0,25
- Max. Cable section	2.5
Pre-wired cable	rigid or flexible
Tightening torque for the terminals	0,6
Detachable terminals (Y/N)	No
Mechanical life	20.000.000 operations
Electrical lifetime	150.000 operations for 230 VAC, 5 A (cos φ = 1)
resistance to shock	30 g / 11 ms
Resistance to vibration To EN 60068-2-6	10...55 HZ, Amplitude 0,35 mm, ± 15 %

Ambient conditions

Ambient temperature	
- Min. environmental temperature	0
- Max. environmental temperature	+55
Storage and transport temperature	
- Min. Storage and transport temperature	-25
- Max. Storage and transport temperature	+70
Protection class	
- Protection class-Enclosure	IP40
- Protection class-Terminals	IP20
- Protection class-Clearance	IP54
Air clearances and creepage distances To IEC/EN 60664-1	
- Rated impulse withstand voltage U _{imp}	4.8 kV
- Overvoltage category	III To VDE 0110
- Degree of pollution	2 To VDE 0110

Electromagnetic compatibility (EMC)

EMC rating 10 V/m

Electrical data

Rated DC voltage for controls

- Max. rated DC voltage for controls 20.4
- Max. rated DC voltage for controls 27.6

Rated AC voltage for controls, 50 Hz

- Min. rated AC voltage for controls, 50 Hz -
- Max. rated AC voltage for controls, 50 Hz -

Rated AC voltage for controls, 60 Hz

- Min. rated AC voltage for controls, 60 Hz -
- Max. rated AC voltage for controls, 60 Hz -

Contact resistance max. 100 mΩ

Power consumption < 5

Type of actuation DC

Switch frequency 1

Rated insulation voltage U_i 250 V

Rated operating voltage U_e 24 VDC $\pm 15\%$

Thermal test current I_{the} 6 A

Operating current I_e 0,2 A

Electronic protection (Y/N) No

Inputs

Monitored inputs

- Short-circuit recognition (Y/N) optional
- Wire breakage detection (Y/N) Yes
- Earth connection detection (Y/N) Yes

Number of shutters adjustable 1 - >0

Number of openers adjustable 1 - >2

Input resistance approx. 4000 Ω at GND

Input signal "1" 10 ... 30 VDC

Input signal "0" 0 ... 2 VDC

Cable length 1000 m with 0,75 mm² (for Rated voltage)

Outputs

Stop category 0

Number of safety contacts 1

Number of auxiliary contacts 0

Number of signalling outputs 2

Switching capacity

- Switching capacity of the safety contacts min. 10 mA, max. 6 A
- Switching capacity of the signaling/diagnostic outputs min. $U_e - 4V$ / Y1, Y2: max. 100 mA

Fuse rating

- Protection of the safety contacts 6 A gG D-fuse
- Fuse rating for the signaling/diagnostic outputs short-circuit proof

Signalling output Y1: Authorized operation, safety contacts on;
Y2: Status NO contact input

Utilisation category To EN 60947-5-1 AC-15: 230 V / 3 A
DC-13: 24 V / 2 A

Number of undelayed semi-conductor outputs with signaling function	2
Number of undelayed outputs with signaling function (with contact)	0
Number of delayed semi-conductor outputs with signaling function.	0
Number of delayed outputs with signalling function (with contact).	0
Number of secure undelayed semi-conductor outputs with signaling function	0
Number of secure, undelayed outputs with signaling function, with contact.	0
Number of secure, delayed semi-conductor outputs with signaling function	0
Number of secure, delayed outputs with signaling function (with contact).	0

LED switching conditions display

LED switching conditions display (Y/N)	Yes
Number of LED's	1

Integral system diagnosis \$missingShortName\$

Integral system diagnosis ISD

- The following faults are registered by the safety monitoring modules and indicated by ISD
- Failure of door contacts to open or close
- Cross-wire or short-circuit monitoring of the switch connections
- Interruption of the switch connections
- Failure of the safety relay to pull-in or drop-out
- Fault on the input circuits or the relay control circuits of the safety monitoring module

Miscellaneous data

Applications



Safety sensor



Guard system

Dimensions

Dimensions

- | | |
|----------|---------|
| - Width | 22.5 mm |
| - Height | 100 mm |
| - Depth | 121 mm |

notice

Inductive loads (e.g. contactors, relays, etc.) are to be suppressed by means of a suitable circuit.

notice - Wiring example

To secure a guard door up to PL 3 and Category #03#

Monitoring 1 guard door(s), each with a magnetic safety sensor of the BNS range

If one or two external relays or contactors are used to switch the load, the system can then only be classified in Category 3 to EN ISO 13849-1, if exclusion of the fault "Failure of the external contactors" can be substantiated and is documented, e.g. by using reliable down-rated contactors. A second contactor leads to an increase in the level of security by redundant switching to switch the load off.

Modification for 2 NC contacts:

The safety monitoring module can be modified to monitor two NC contacts by bridging the terminals A1 and X1. The short-circuit recognition between connections then becomes inoperative.

Expansion of enable delay time:

The enable delay time can be increased from 0,1 s to 1,0 s by changing the position of a jumper link connection under the cover of the unit.

The wiring diagram is shown with guard doors closed and in de-energised condition.

The ISD tables (Integral System Diagnostics) for analysis of the fault indications and their causes are shown in the appendix.

Documents

Operating instructions and Declaration of conformity (fr) 316 kB, 21.04.2011

Code: mrl_aes1136-2185_fr

Operating instructions and Declaration of conformity (pt) 205 kB, 21.08.2013

Code: mrl_aes1136-2185_pt

Operating instructions and Declaration of conformity (en) 315 kB, 21.04.2011

Code: mrl_aes1136-2185_en

Operating instructions and Declaration of conformity (da) 204 kB, 09.07.2013

Code: mrl_aes1136-2185_da

Operating instructions and Declaration of conformity (it) 314 kB, 21.04.2011

Code: mrl_aes1136-2185_it

Operating instructions and Declaration of conformity (pl) 206 kB, 28.08.2013

Code: mrl_aes1136-2185_pl

Operating instructions and Declaration of conformity (de) 389 kB, 28.02.2011

Code: mrl_aes1136-2185_de

Operating instructions and Declaration of conformity (jp) 394 kB, 07.06.2011

Code: mrl_aes1136-2185_jp

Operating instructions and Declaration of conformity (es) 316 kB, 21.04.2011

Code: mrl_aes1136-2185_es

Operating instructions and Declaration of conformity (nl) 381 kB, 21.04.2011

Code: mrl_aes1136-2185_nl

Wiring example (99) 17 kB, 22.08.2008

Code: Maes1I01

Wiring example (99) 18 kB, 22.08.2008

Code: Maes1I02

ISD tables (Integral System Diagnostics) (de) 51 kB, 29.07.2008

Code: i_ae2p01

ISD tables (Integral System Diagnostics) (en) 35 kB, 29.07.2008

Code: i_ae2p02

BG-test certificate (en) 756 kB, 27.08.2018

Code: z_135p02

BG-test certificate (de) 768 kB, 27.08.2018

Code: z_135p01

BG-test certificate (en) 1 MB, 17.08.2018

Code: z_113p02

BG-test certificate (de) 1 MB, 17.08.2018

Code: z_113p01


EAC certification (ru) 1 MB, 15.03.2018

Code: q_aesp01


Images




Product photo

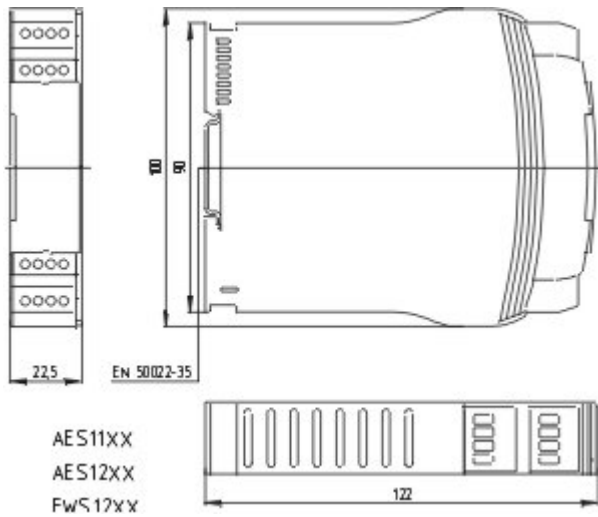

Dimensional drawing (basic component)

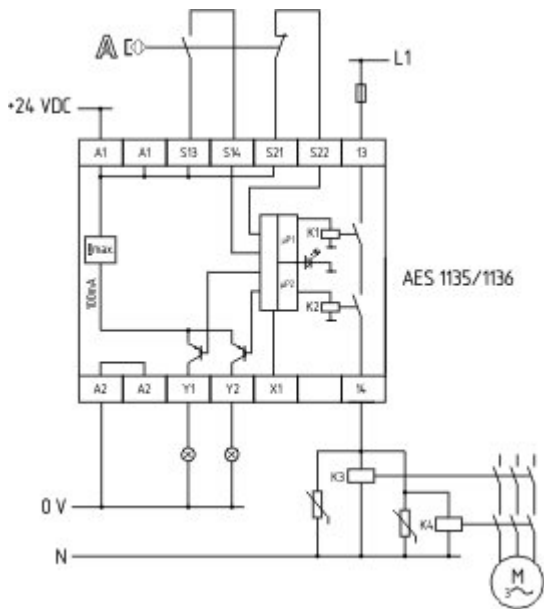

Wiring example

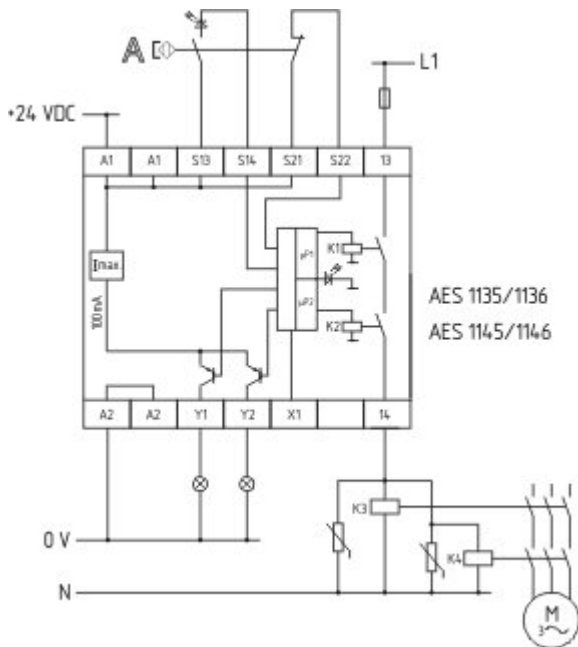

Wiring example

K.A. Schmersal GmbH & Co. KG, Mödinghofe 30, D-42279 Wuppertal

The data and values have been checked thoroughly. Technical modifications and errors excepted.

Generiert am 13.02.2019 - 13:04:21h Kasbase 3.3.0.F.64I